


**LOW PROFILE ROUNDABOUT KERB NOTES:**

1. ALL CONCRETE KERBING MUST BE CONSTRUCTED IN ACCORDANCE WITH AS 2876.
2. CONCRETE STRENGTH TO BE 32MPa UNLESS NOTED OTHERWISE.
3. FOR INSTALLATION REQUIREMENTS, REFER TO KERB INSTALLATION DETAIL(S).

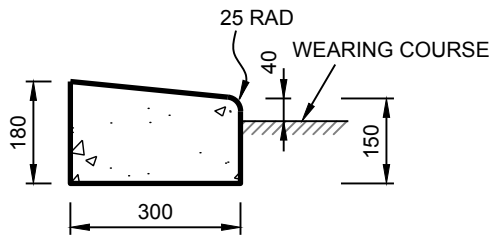

**LOW PROFILE ROUNDABOUT KERB (SD-115)**  
 (RAB)  
 NOT TO SCALE

1. All dimensions are in millimeters unless otherwise shown.
2. It is the responsibility of the individual to ensure that they are using the current version of this drawing. Council accepts no liability for issues arising from the use of superseded drawings. Printed copies of this drawing are uncontrolled.

REV	DESCRIPTION	APPROVED	DATE	APPROVED TEAM LEADER TECHNICAL SERVICES	<b>LOW PROFILE ROUNDABOUT KERB (RAB)</b>
D	REMOVED REINFORCING MESH	C.HASKAS	FEB '18	<i>Chris Haskas</i>	
C	REVISED NOTES	C.HASKAS	AUG '12		
B	INCREASED LIP TO 40mm	P.BICKLEY	MAY '11		
A	ORIGINAL ISSUE	P.BICKLEY	JUN '10		

<b>CITY OF ONKAPARINGA</b>	STANDARD # <b>SD-115</b>	REV <b>D</b>
--------------------------------	-----------------------------	-----------------