



- GRADED INLET PIT (TYPE 1) NOTES:**
1. THIS PIT IS NOT TO BE USED FOR PIT DEPTHS (D) GREATER THAN 900mm.
 2. WHERE COVER IS NOT SUBJECT TO SURFACE LOADING, A LIGHT DUTY COVER AND FRAME BY 'BIANCO' OR SIMILAR APPROVED MAY BE USED.
 3. CONCRETE STRENGTH TO BE 32MPa UNLESS NOTED OTHERWISE.
 4. GROUT TO CONSIST OF 2 PARTS SAND, 1 PART CEMENT AND SUFFICIENT WATER TO PRODUCE MIX OF SUITABLE CONSISTENCY.
 5. ACCESS COVERS & GRATES TO BE IN ACCORDANCE WITH AS 3986.
 6. GRATES SHALL BE BICYCLE TYRE PENETRATION RESISTANT (BTPR) IN BOTH DIRECTIONS.
 7. BOLT DOWN GRATES TO BE USED UNLESS NOTED OTHERWISE.
 8. CONCRETE BENCHING (STREAMLINING) IS TO BE PROVIDED FOR ALL DRAINAGE PITS (REFER SD-210).

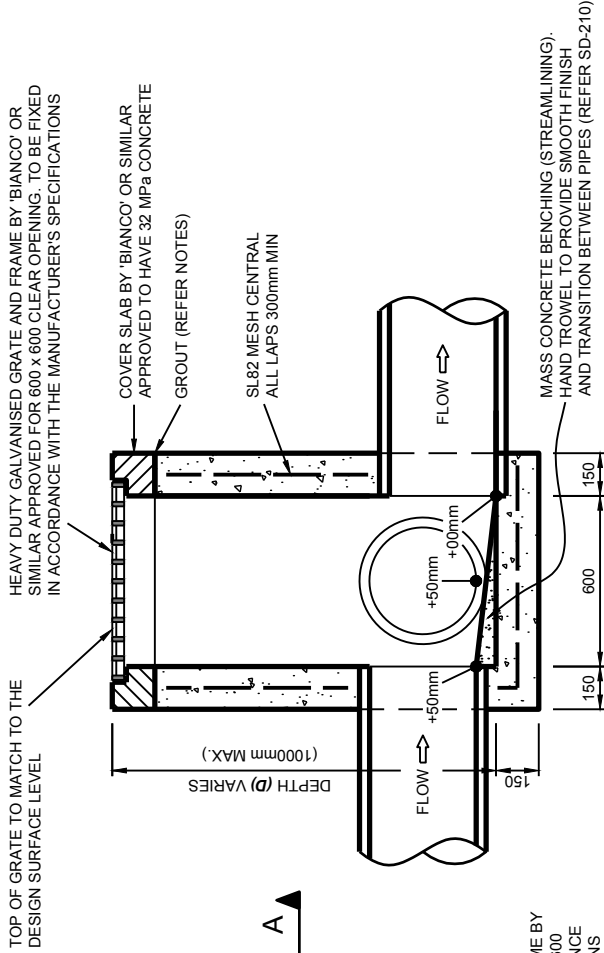

SECTION A-A

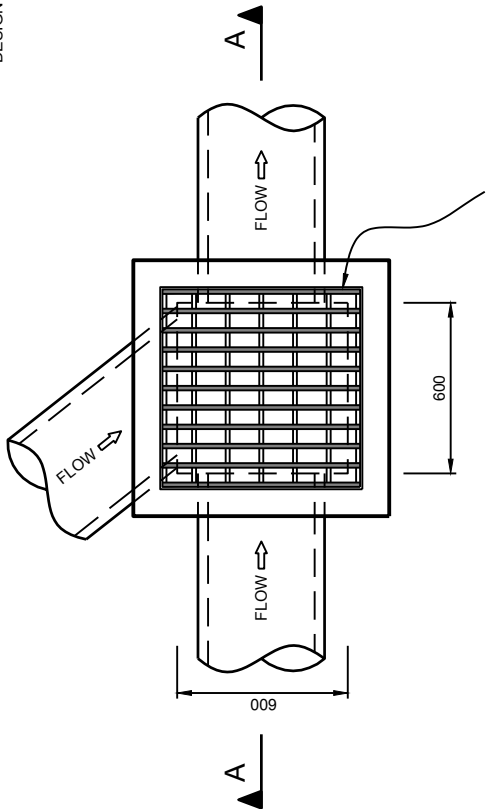

PLAN VIEW

GRADED INLET PIT (TYPE 1) (SD-202)
FOR PIPE SIZES ≤ Ø450mm
NOT TO SCALE

1. All dimensions are in millimeters unless otherwise shown.
2. It is the responsibility of the individual to ensure that they are using the current version of this drawing. Council accepts no liability for issues arising from the use of superseded drawings. Printed copies of this drawing are uncontrolled.

REV	DESCRIPTION	APPROVED	DATE	APPROVED TEAM LEADER TECHNICAL SERVICES	GRADED INLET PIT (TYPE 1) FOR PIPE SIZES ≤ Ø450mm		STANDARD #	REV
C	REVISED NOTES	C.HASKAS	FEB '18	<i>Urris Haskas</i>			SD-202	C
B	REVISED DETAIL & NOTES	C.HASKAS	AUG '12		SCALE AT A4 NOT TO SCALE			
A	ORIGINAL ISSUE	P.BICKLEY	JUN '10					