



- FIELD GULLY PIT NOTES:**
1. FOR SWALES IN WATER SENSITIVE URBAN DESIGN (WSUD) APPLICATIONS, THE CLEAR OPENING MAY BE REDUCED TO 50mm AND THE CONCRETE APRON MAY BE REPLACED WITH ROCK PITCHING AS REQUIRED. PROPOSED ALTERATIONS ARE TO BE FORWARDED TO TECHNICAL SERVICES FOR APPROVAL.
 2. FOR PITS ADJACENT TO THE ROAD, GUIDEPOSTS AND/OR WARNING SIGNS WILL BE REQUIRED. REFER TO TECHNICAL SERVICES FOR INFORMATION & APPROVAL.
 3. FOR PIT DEPTHS (D) GREATER THAN 1.5m A PROPOSED DESIGN IS TO BE FORWARDED TO TECHNICAL SERVICES FOR APPROVAL.
 4. STEP IRONS SHALL BE INSTALLED IN ALL PITS WHERE PIT DEPTH (D) IS GREATER THAN 1.2m (REFER SD-216).
 5. WHERE COVER IS NOT SUBJECT TO SURFACE LOADING, A LIGHT DUTY COVER AND FRAME BY 'BIANCO' OR SIMILAR APPROVED MAY BE USED.
 6. CONCRETE STRENGTH TO BE 32MPa UNLESS NOTED OTHERWISE.
 7. GROUT TO CONSIST OF 2 PARTS SAND, 1 PART CEMENT AND SUFFICIENT WATER TO PRODUCE MIX OF SUITABLE CONSISTENCY.
 8. BOLT DOWN GRATES TO BE USED UNLESS NOTED OTHERWISE. ACCESS COVERS & GRATES TO BE IN ACCORDANCE WITH AS 3996.
 9. CONCRETE BENCHING (STREAMLINING) IS TO BE PROVIDED FOR ALL DRAINAGE PITS (REFER SD-210).
 10. PROVIDE 'CONFINED SPACE' WARNING SIGN (REFER SD-211).

100 THICK CONCRETE APRON 600 WIDE

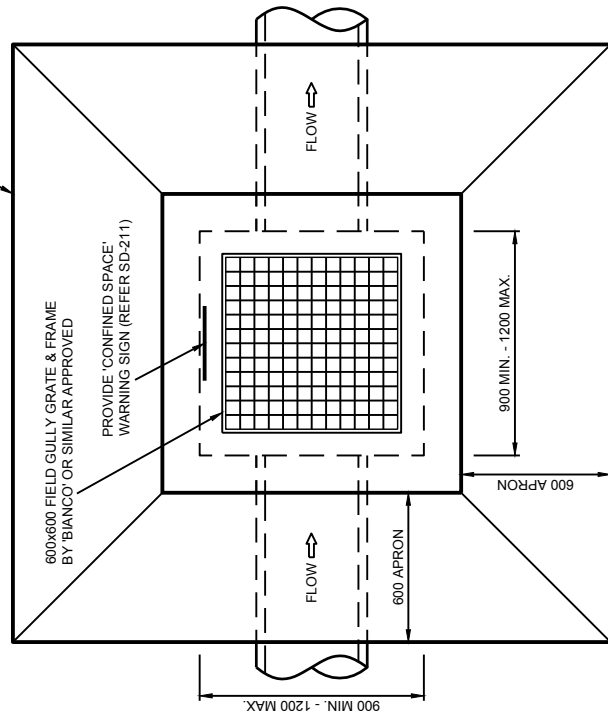

PLAN VIEW

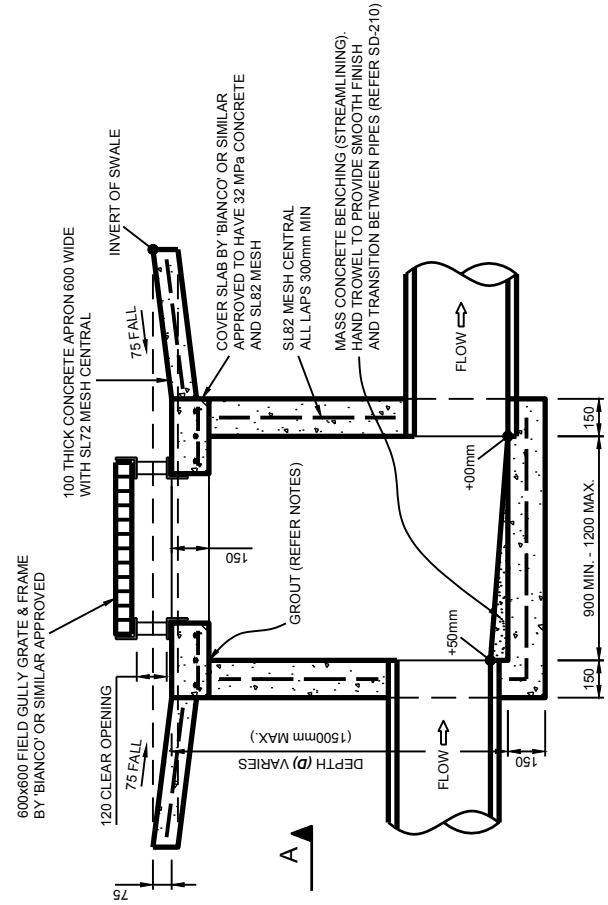

SECTION A-A

FIELD GULLY PIT (SD-205)
WITH 600mm CONCRETE APRON
NOT TO SCALE

1. All dimensions are in millimeters unless otherwise shown.
2. It is the responsibility of the individual to ensure that they are using the current version of this drawing. Council accepts no liability for issues arising from the use of superseded drawings. Printed copies of this drawing are uncontrolled.

REV	DESCRIPTION	APPROVED	DATE	APPROVED TEAM LEADER TECHNICAL SERVICES	FIELD GULLY PIT WITH 600mm CONCRETE APRON	CITY OF ONKAPARINGA	STANDARD # SD-205	REV C
				<i>Urris Haskas</i>				
C	REVISED NOTES	C.HASKAS	FEB '18					
B	REVISED DETAIL & NOTES	C.HASKAS	AUG '12					
A	ORIGINAL ISSUE	P.BICKLEY	JUN '10					