
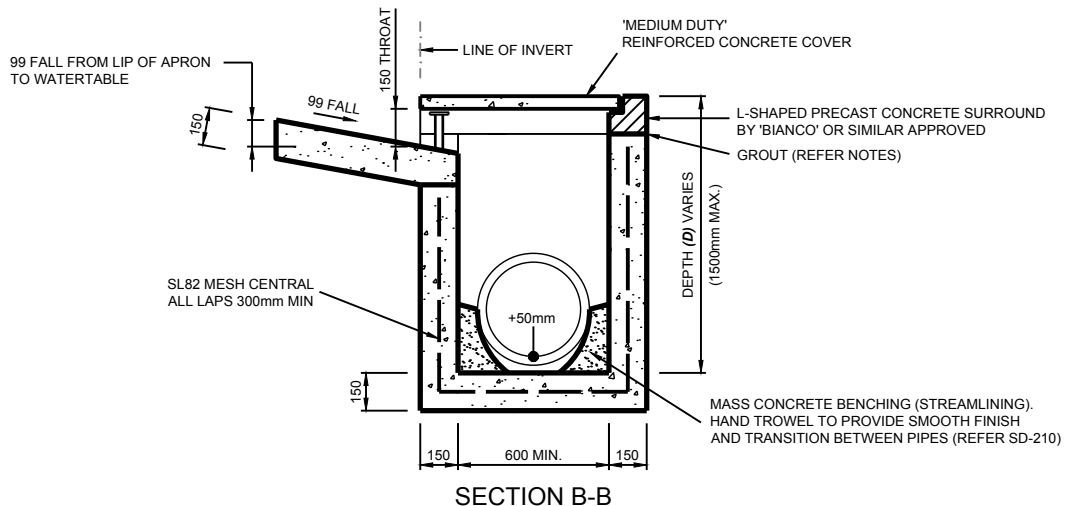
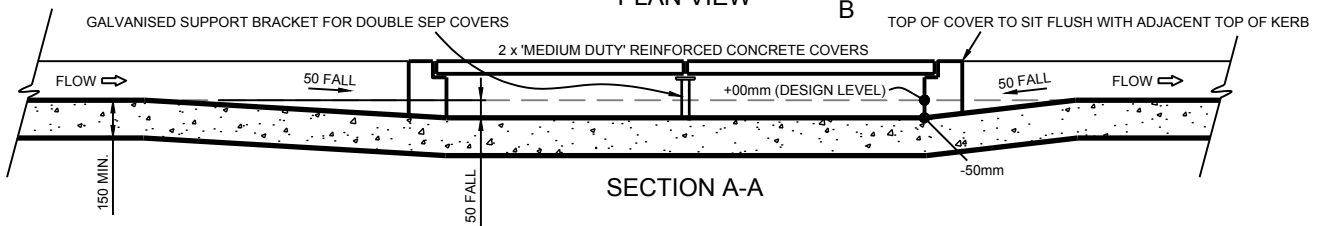


**DOUBLE SIDE ENTRY PIT (TYPE 3) NOTES:**

1. COVER & FRAME TYPE SIDE ENTRY PITS SHALL NOT BE USED FOR NEW INFRASTRUCTURE PROJECTS.
2. DEFLECTORS ARE TO BE PROVIDED WHERE APPROACH GRADE IS GREATER THAN 2.0% (REFER SD-209).
3. A 1200mm TRANSITION TO THE APRON IS TO BE PROVIDED ON BOTH SIDES OF SEP IF THE PIT IS IN A SAG-POINT LOCATION.
4. FOR PIT DEPTHS (D) GREATER THAN 1.5m A PROPOSED DESIGN IS TO BE FORWARDED TO TECHNICAL SERVICES FOR APPROVAL.
5. STEP IRONS SHALL BE INSTALLED IN ALL PITS WHERE PIT DEPTH (D) IS GREATER THAN 1.2m (REFER SD-216).
6. CONCRETE STRENGTH TO BE 32MPa UNLESS NOTED OTHERWISE.
7. GROUT TO CONSIST OF 2 PARTS SAND, 1 PART CEMENT AND SUFFICIENT WATER TO PRODUCE MIX OF SUITABLE CONSISTENCY.
8. ACCESS COVERS & GRATES TO BE IN ACCORDANCE WITH AS 3996.
9. ALL STEEL COMPONENTS TO BE HOT DIP GALVANISED.
10. CONCRETE BENCHING (STREAMLINING) IS TO BE PROVIDED FOR ALL DRAINAGE PITS (REFER SD-210).
11. PROVIDE 'CONFINED SPACE' WARNING SIGN (REFER SD-211).
12. SIDE ENTRY PITS SHALL BE LOCATED BEYOND THE TANGENT POINT OF KERB RADIUS'.

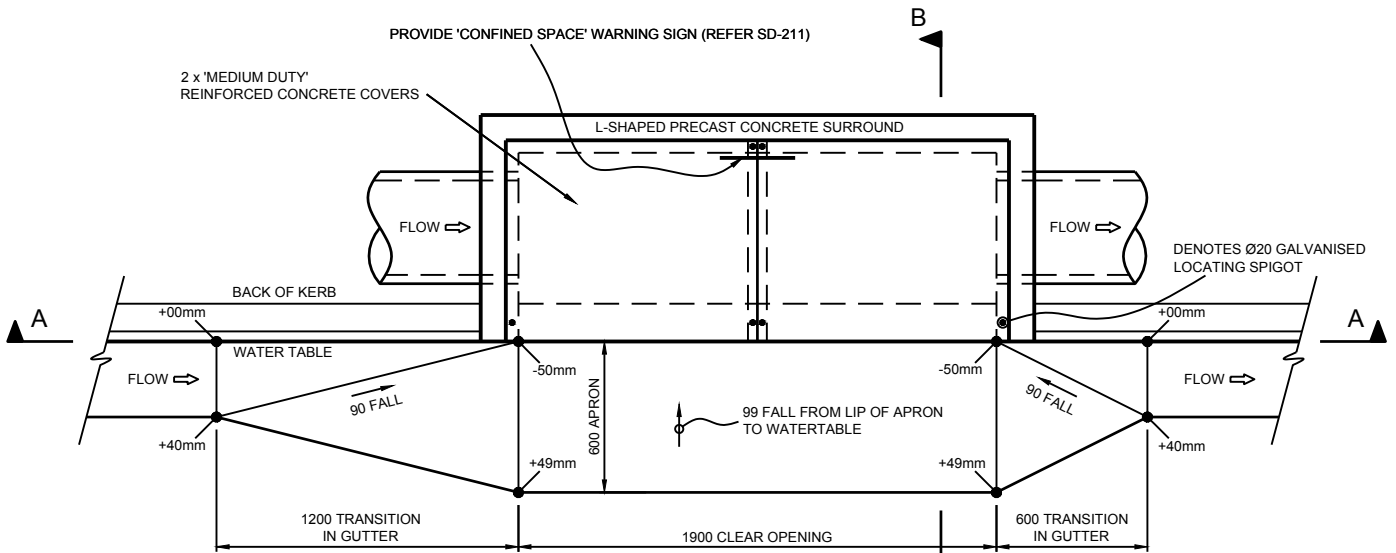

**DOUBLE SIDE ENTRY PIT (TYPE 3) (SD-208)**

COVER & FRAME TYPE - WITHOUT DEFLECTORS  
NOT TO SCALE

1. All dimensions are in millimeters unless otherwise shown.
2. It is the responsibility of the individual to ensure that they are using the current version of this drawing. Council accepts no liability for issues arising from the use of superseded drawings. Printed copies of this drawing are uncontrolled.

REV	DESCRIPTION	APPROVED	DATE	APPROVED TEAM LEADER TECHNICAL SERVICES	DOUBLE SIDE ENTRY PIT (TYPE 3) COVER & FRAME TYPE - WITHOUT DEFLECTORS		
D	REVISED DETAIL & NOTES	C.HASKAS	FEB '18	 SCALE AT A4 NOT TO SCALE		STANDARD #	REV
C	REVISED DETAIL & NOTES	C.HASKAS	AUG '12			SD-208	D
B	ADDED DESIGN LEVEL LINE	P.BICKLEY	MAY '11				
A	ORIGINAL ISSUE	P.BICKLEY	JUN '10				