


**ALLOTMENT CONNECTION TO DRAIN NOTES:**

1. ALL ALLOTMENT CONNECTION PIPES TO BE MINIMUM Ø100 UPVC - SEWER CLASS.
2. ALL CONNECTIONS TO COUNCIL'S STORMWATER DRAINAGE NETWORK ARE TO BE INSPECTED BY COUNCIL'S REPRESENTATIVE PRIOR TO BACKFILLING.
3. REAR OF ALLOTMENT DRAIN BACKFILLING TO BE IN ACCORDANCE WITH AS 3725.
4. FOR ALLOTMENT CONNECTION DETAILS REFER SD-220, SD-221 & SD-222.

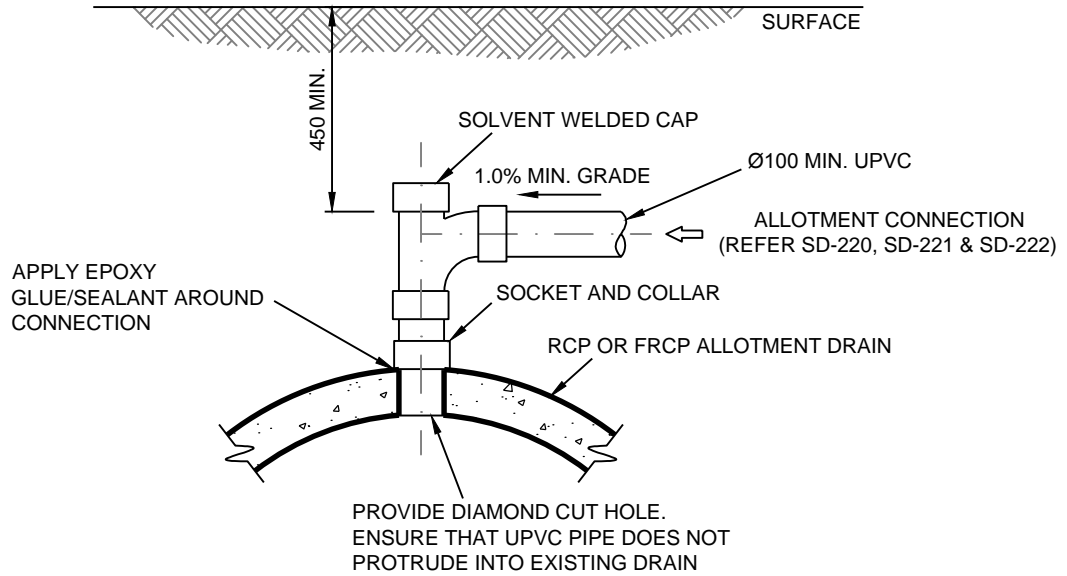

**SECTION**

**ALLOTMENT CONNECTION TO DRAIN (SD-223)**

TO RCP OR FRCP ALLOTMENT DRAIN  
 FOR FRONT OR REAR OF ALLOTMENT DRAIN CONNECTIONS  
 NOT TO SCALE

1. All dimensions are in millimeters unless otherwise shown.
2. It is the responsibility of the individual to ensure that they are using the current version of this drawing. Council accepts no liability for issues arising from the use of superseded drawings. Printed copies of this drawing are uncontrolled.

REV	DESCRIPTION	APPROVED	DATE	APPROVED TEAM LEADER TECHNICAL SERVICES	ALLOTMENT CONNECTION TO DRAIN TO RCP OR FRCP ALLOTMENT DRAIN FOR FRONT OR REAR OF ALLOTMENT DRAIN CONNECTIONS	CITY OF ONKAPARINGA	STANDARD # SD-223	REV B
				<i>Urris Haskas</i>				
B	REVISED TITLE	C.HASKAS	AUG '12	SCALE AT A4				
A	ORIGINAL ISSUE	P.BICKLEY	JUN '10	NOT TO SCALE				