


FOOTPATH & RETAINING WALL NOTES:

1. FOR REQUIRED FOOTPATH WIDTHS & LOCATIONS REFER TO THE DESIGN PLANS, PROJECT SCOPE & COUNCIL'S 'FOOTPATH NETWORK ASSET MANAGEMENT PLAN'.
2. RETAINING WALL BLOCKS TO BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.
3. BACKFILL SHOULD BE NO HIGHER THAN THE TOP OF THE RETAINING WALL.
4. 'LIQUID NAILS' OR SIMILAR APPROVED CONSTRUCTION ADHESIVE IS TO BE USED TO FIX THE TOP COURSE OF RETAINING WALL IN PLACE. PROVIDE A CONTINUOUS BEAD APPROXIMATELY 10mm WIDE TO THE UNDERSIDE OF THE RETAINING WALL BLOCK BOTH FRONT & BACK.
5. FOR RETAINING WALLS WHERE (H) ≥ 1000mm A SEPARATE DEVELOPMENT APPROVAL IS REQUIRED AND A PROPOSED DESIGN SHALL BE FORWARDED TO TECHNICAL SERVICES FOR APPROVAL.
6. FOR BACKFILLING OF DRAINAGE OR SERVICE TRENCHES BELOW FOOTPATH BASE LEVEL REFER TO SD-432 & SD-433.

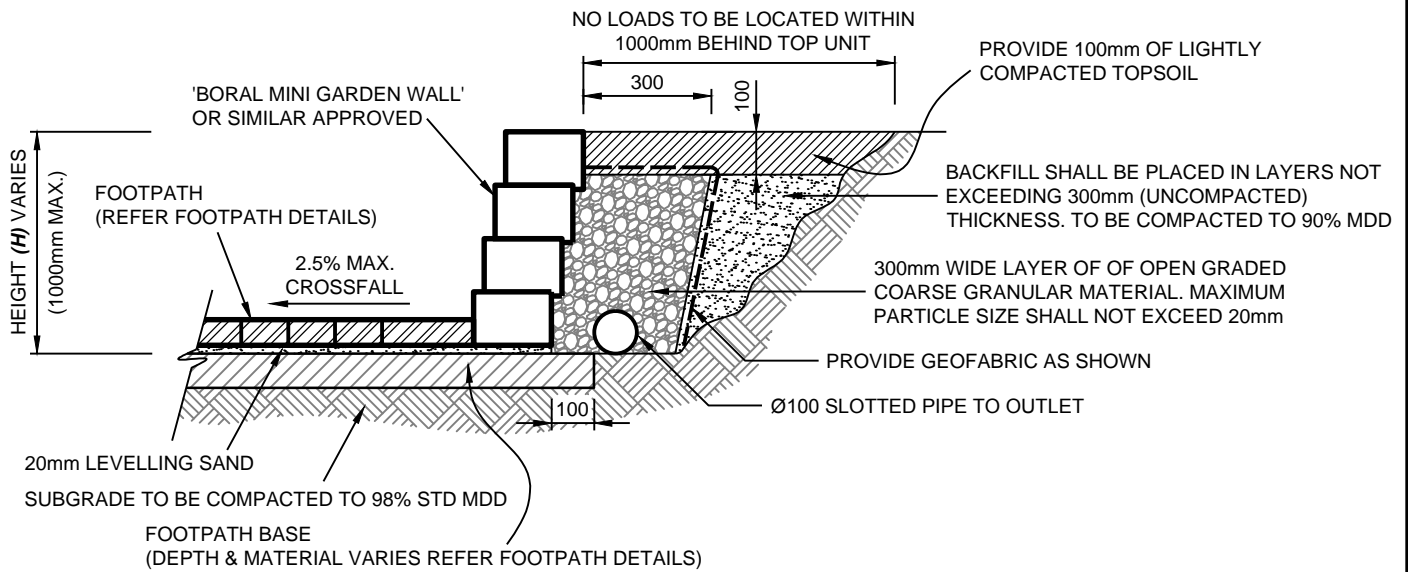

FOOTPATH & RETAINING WALL (SD-304)

RETAINING WALL ADJACENT FOOTPATH
NOT TO SCALE

1. All dimensions are in millimeters unless otherwise shown.
2. It is the responsibility of the individual to ensure that they are using the current version of this drawing. Council accepts no liability for issues arising from the use of superseded drawings. Printed copies of this drawing are uncontrolled.

REV	DESCRIPTION	APPROVED	DATE	APPROVED TEAM LEADER TECHNICAL SERVICES	FOOTPATH & RETAINING WALL RETAINING WALL ADJACENT FOOTPATH	STANDARD # SD-304	REV B
				<i>Urris Haskas</i>			
B	REVISED DETAIL & NOTES	C.HASKAS	AUG '12	SCALE AT A4 NOT TO SCALE			
A	ORIGINAL ISSUE	P.BICKLEY	JUN '10				