


CONCRETE APRON INSTALLATION NOTES:

1. INSTALLATION OF KERBING SHALL BE IN ACCORDANCE WITH AS 2876.
2. REFER TO THE DESIGN PLANS FOR LOCATION OF CONCRETE APRON(S).
3. CONCRETE STRENGTH TO BE 32MPa UNLESS NOTED OTHERWISE.
4. CONCRETE APRON TO BE PLACED AT SAME TIME AS ADJACENT KERBING.

CONCRETE APRON TO BE 190mm THICK WITH SL72 MESH PLACED WITH 50mm COVER FROM BOTTOM USING CHAIRS OR SIMILAR. BASE THICKNESS AND COMPACTION TO MATCH THAT OF PROPOSED PAVEMENT DESIGN (REFER DESIGN PLANS).

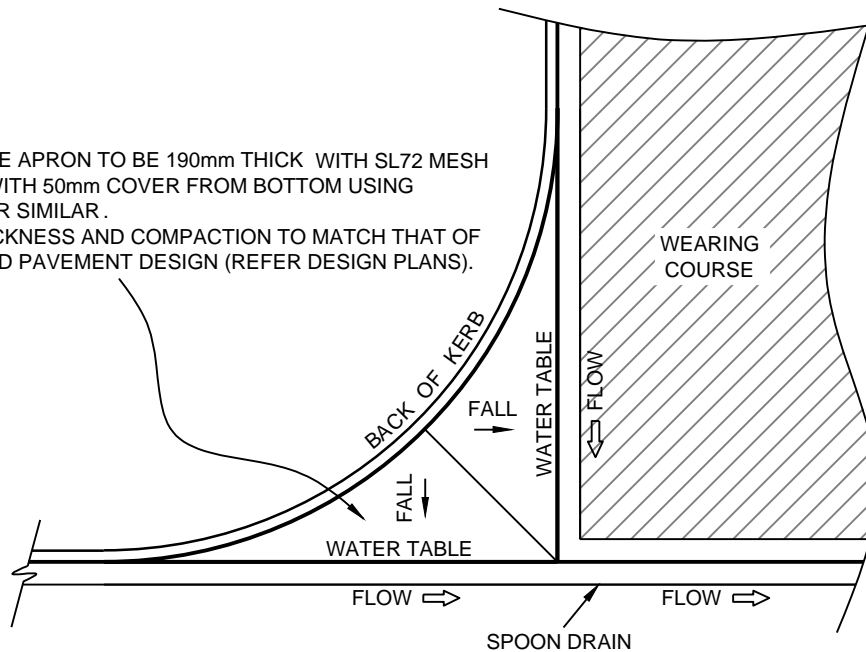

CONCRETE APRON INSTALLATION (SD-411)
TO DIRECT STORMWATER FLOWS AT INTERSECTION
NOT TO SCALE

1. All dimensions are in millimeters unless otherwise shown.
2. It is the responsibility of the individual to ensure that they are using the current version of this drawing. Council accepts no liability for issues arising from the use of superseded drawings. Printed copies of this drawing are uncontrolled.

REV	DESCRIPTION	APPROVED	DATE	APPROVED TEAM LEADER TECHNICAL SERVICES	CONCRETE APRON INSTALLATION TO DIRECT STORMWATER FLOWS AT INTERSECTION	CITY OF ONKAPARINGA	STANDARD # SD-411	REV B
				<i>Urris Haskas</i>				
B	REVISED NOTES	C.HASKAS	AUG '12	SCALE AT A4				
A	ORIGINAL ISSUE	P.BICKLEY	JUN '10	NOT TO SCALE				